


# TRANSFORMER AND SECONDARY CABINET SLAB DETAIL

1500 KVA, 2000 KVA & 2500 KVA TRANSFORMERS

8.09.2

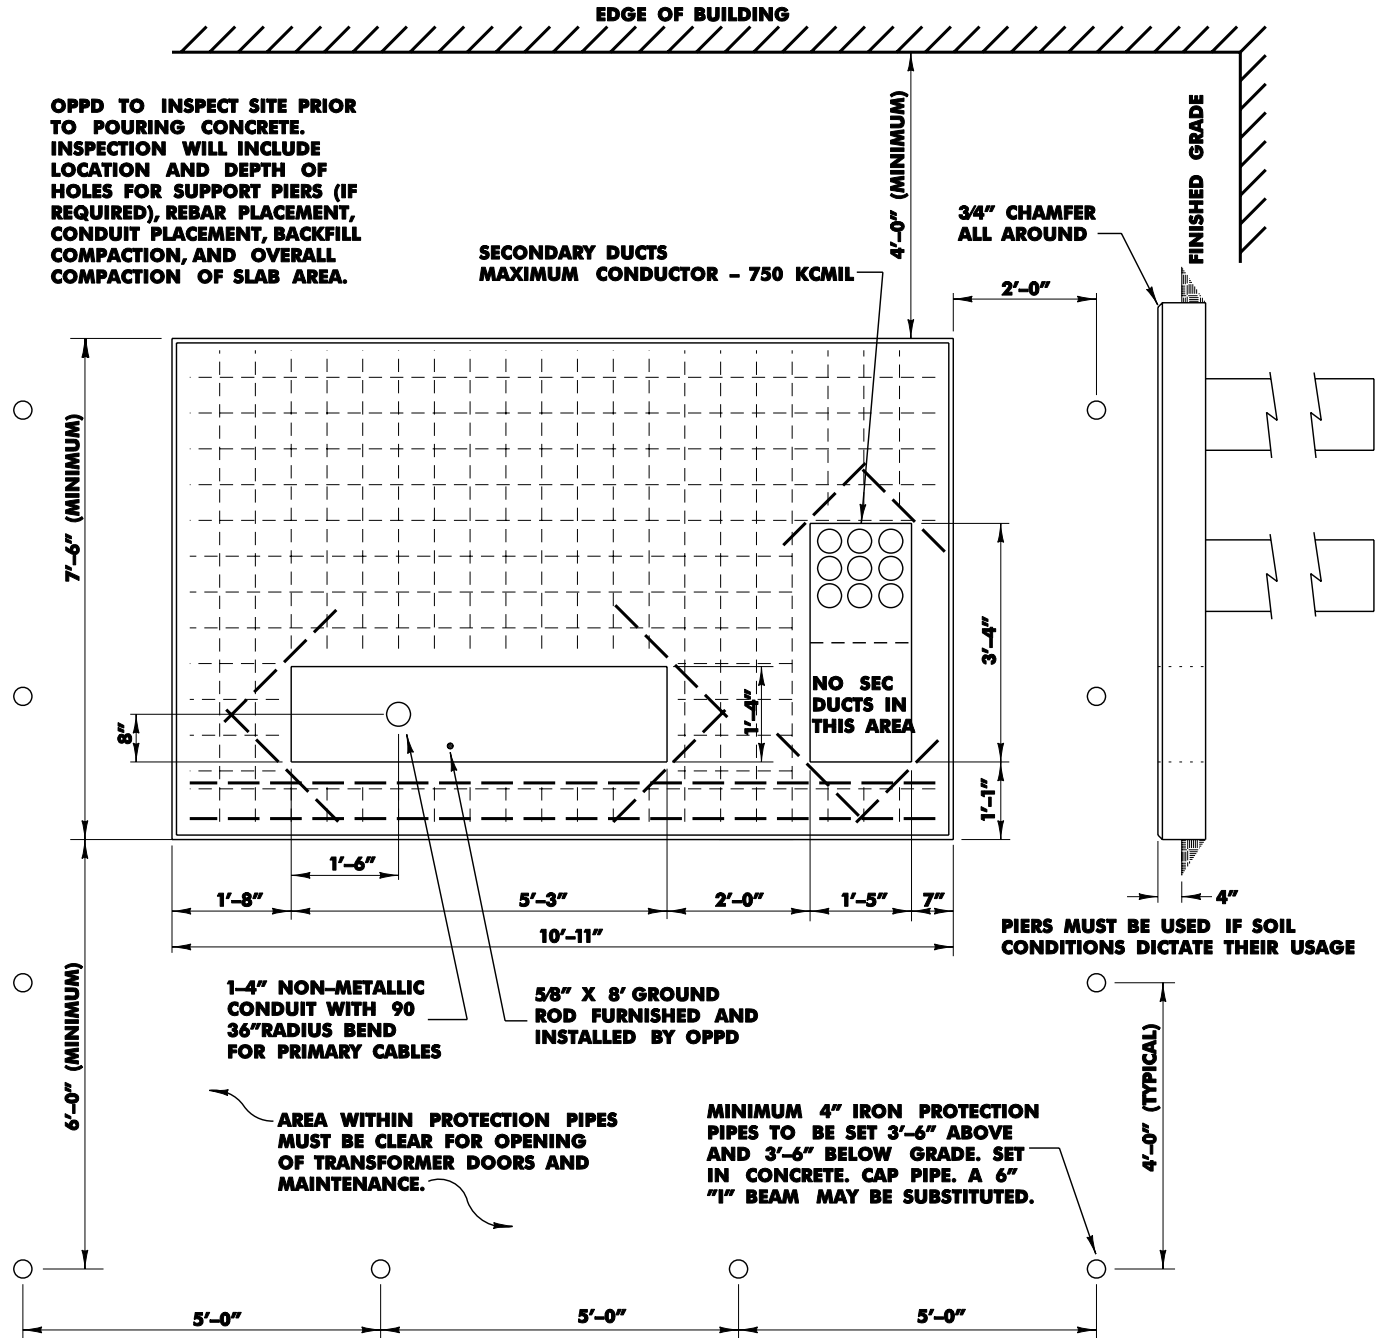

EACH LOCATION SHALL HAVE A SOIL TEST PERFORMED AND A SLAB DESIGNED PER THE RESULTS. BY CUSTOMER

TRANSFORMER SLAB TO BE DESIGNED AND CONSTRUCTED BY CUSTOMER

LOCATION AND DIMENSIONS OF SLOT AND CONDUITS MUST BE MAINTAINED IN RELATION TO OVERALL SLAB DIMENSION

ALL CUSTOMER INSTALLED PRIMARY CONDUITS TO BE RODDED AND PROVEN CLEAR, AND A JET LINE TO BE LEFT IN EACH CONDUIT

DUCTS ARE NOT TO BE INSTALLED IN CONCRETE WITHIN SLOT

OPPD ENGINEERING DEPT MUST REVIEW ALL DETAILS BEFORE CONSTRUCTION

NO WALLS TO BE BUILT AROUND OR CANOPIES ABOVE TRANSFORMERS

ALL CONDUITS ENTERING SLAB TO BE VERTICAL AND AT A 90° ANGLE WITH TOP OF SLAB